


Before switching the timer on, check that the power supply and transformer are properly connected!

**WARNING:**


If the communication cables (A and B) are swapped with other cables, all electronics will be destroyed!!

The cables in the box must be at least 15 cm long (from the wall).



max. 8 buttons
min. 3 buttons

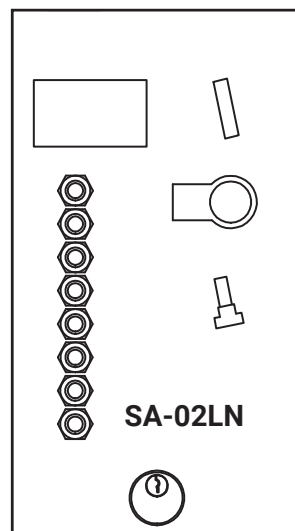

YDY-4x1,5mm² cable
power + communication


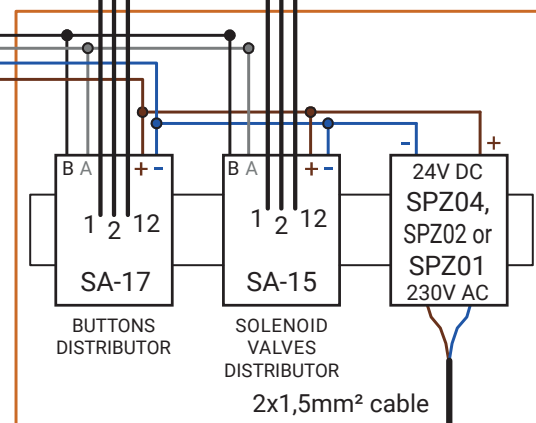
**DISTRIBUTION BOX:**

The maximum cable length from the central unit to the shower is 50 metres (the distributor should be as close as possible to the showers, the location must comply with safety distance standards)!

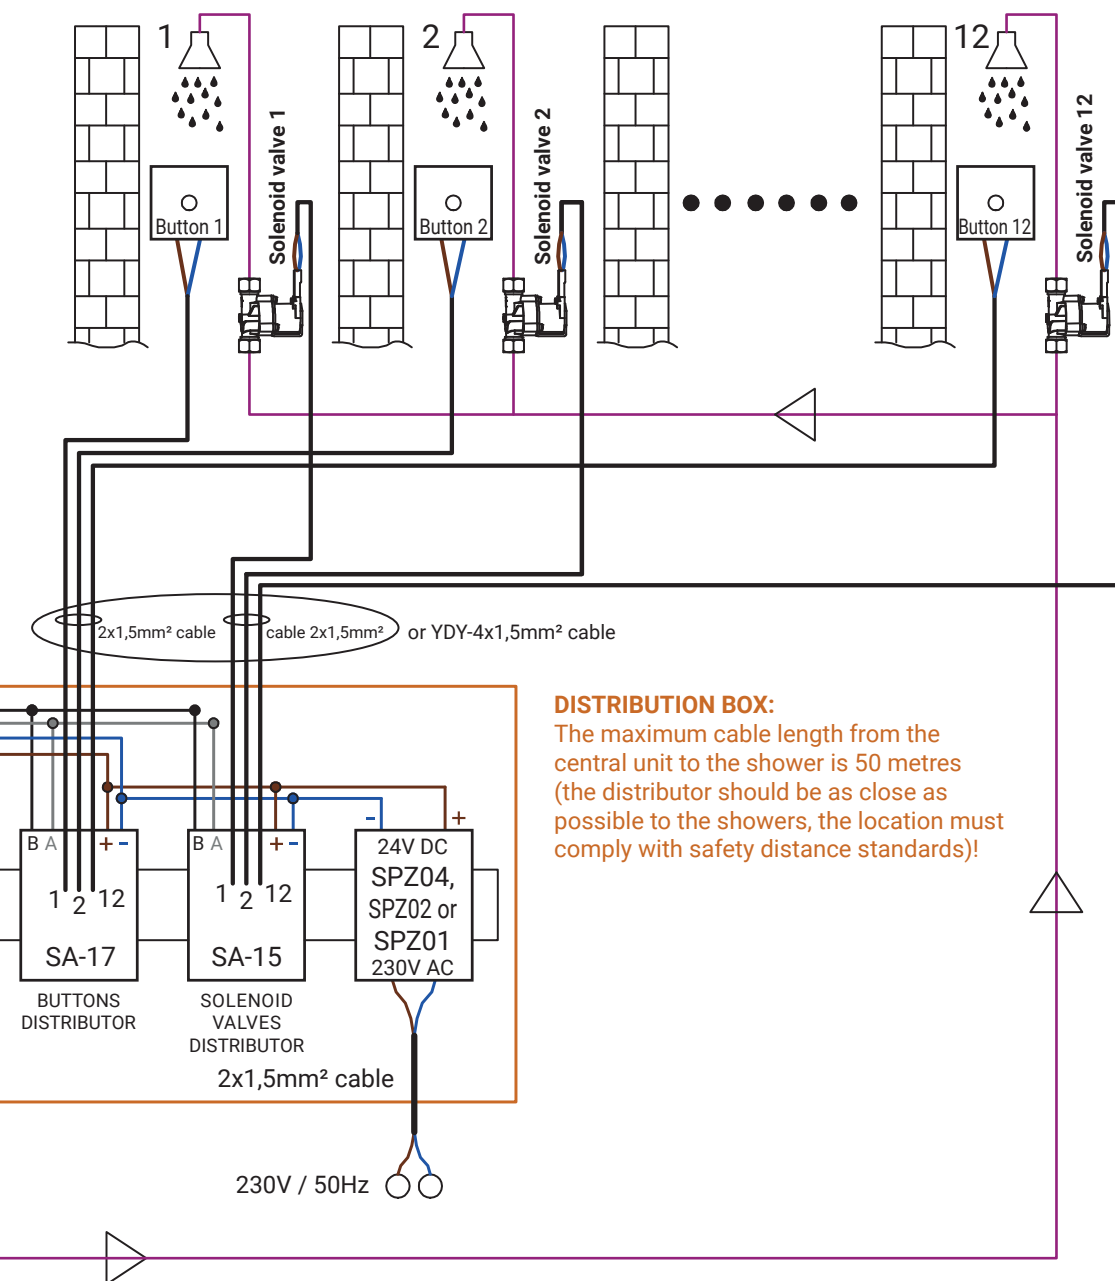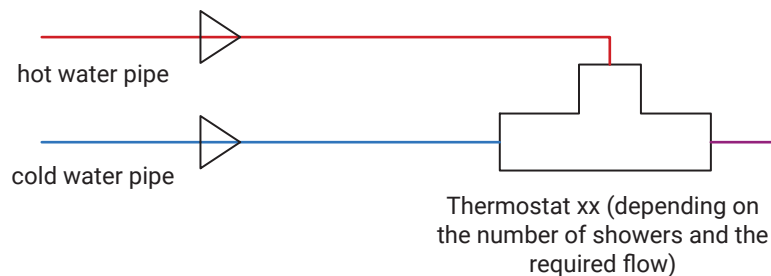

Installation by qualified personnel only
in accordance with all applicable local regulations.

- PCB detail

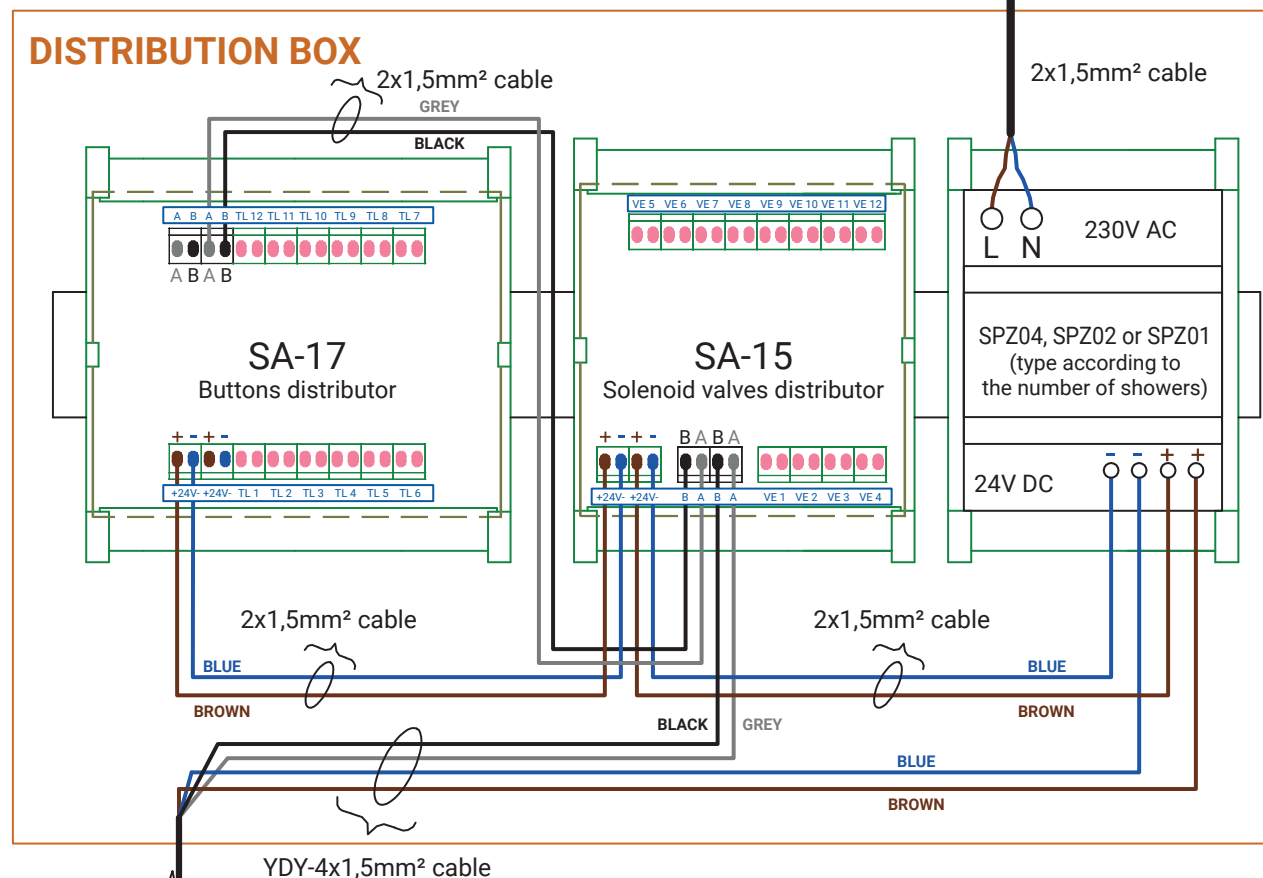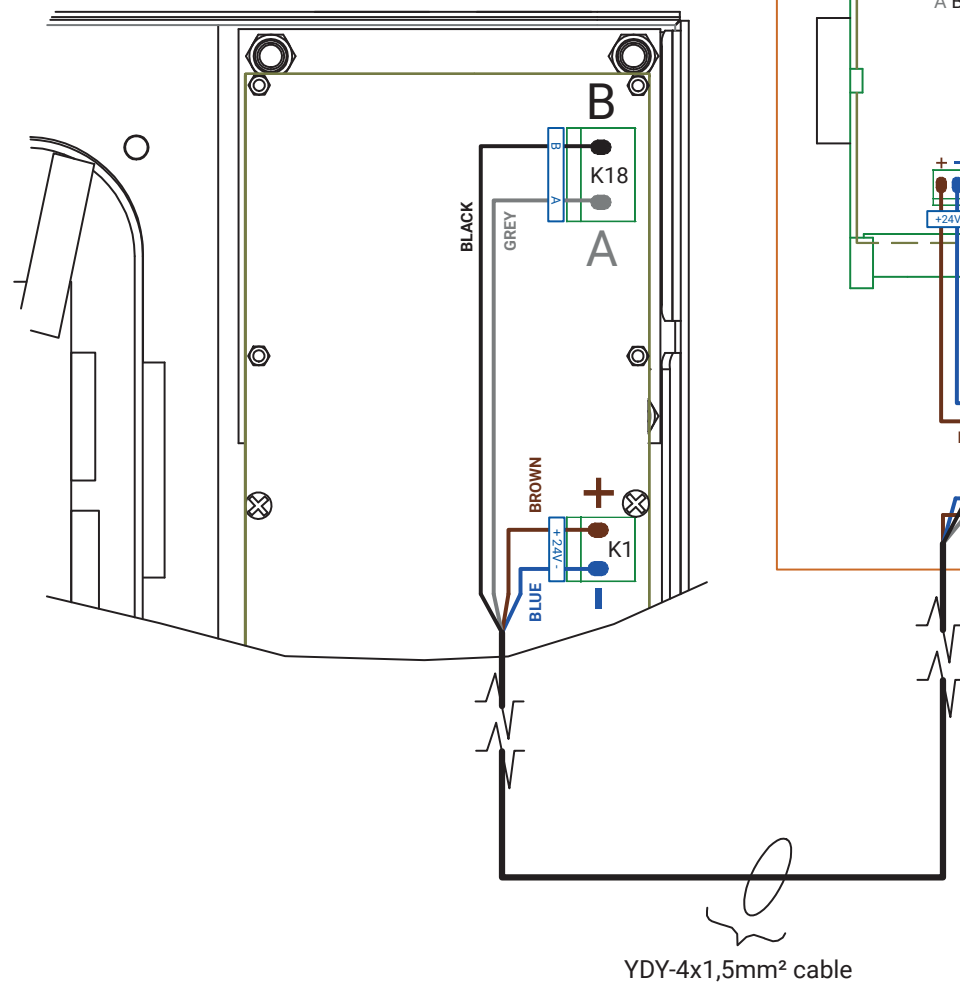

SPZ04Y - for 4 showers (on DIN rail)
 SPZ04Z - for 5 to 8 showers (on DIN rail)
 SPZ04X - for 9 to 12 showers (on DIN rail)
 SPZ02 - for 4 showers
 SPZ01 - for 5 to 8 showers



The distribution box should be as close as possible to the showers, the location must comply with safety distance standards.



WARNING:
If the communication cables (A and B) are swapped with other cables, all electronics will be destroyed!!


CONNECTION OF THE COMMUNICATION

- View of the back panel
- PCB detail

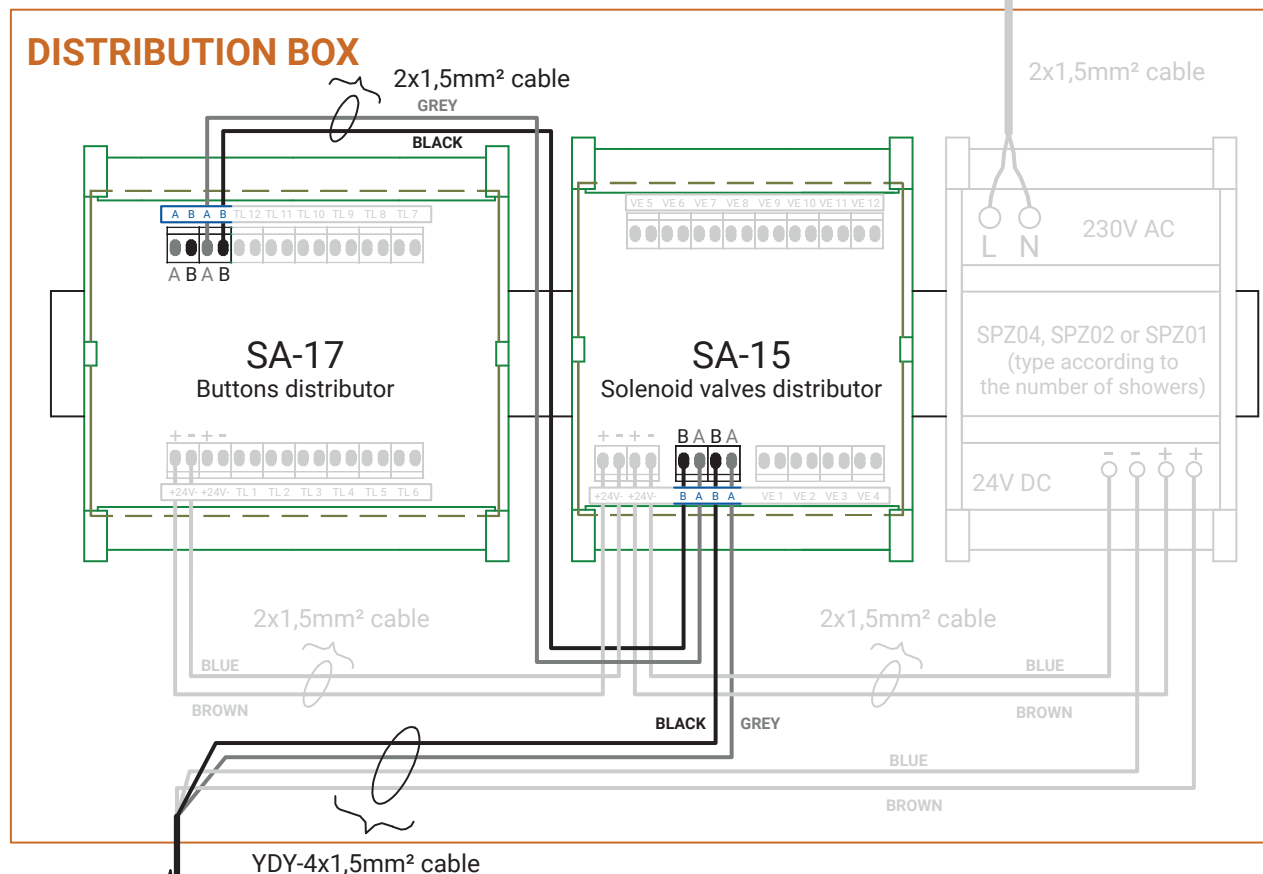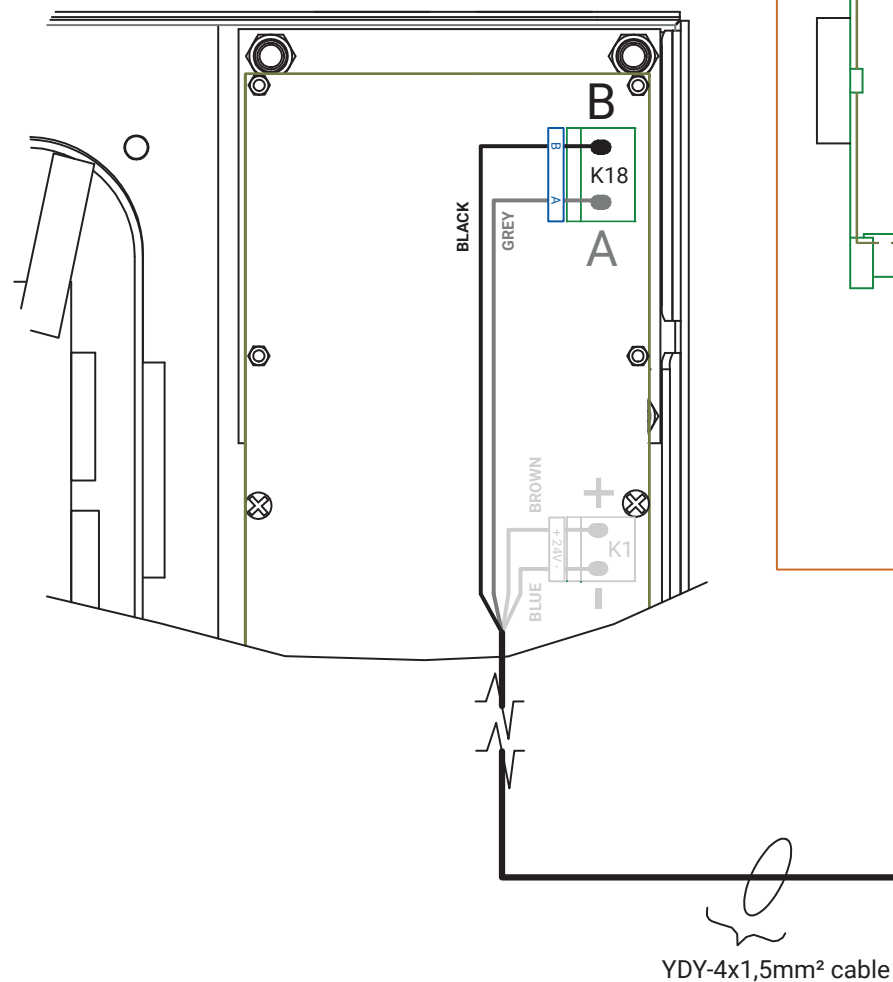


POWER CONNECTION

- View of the back panel
- PCB detail

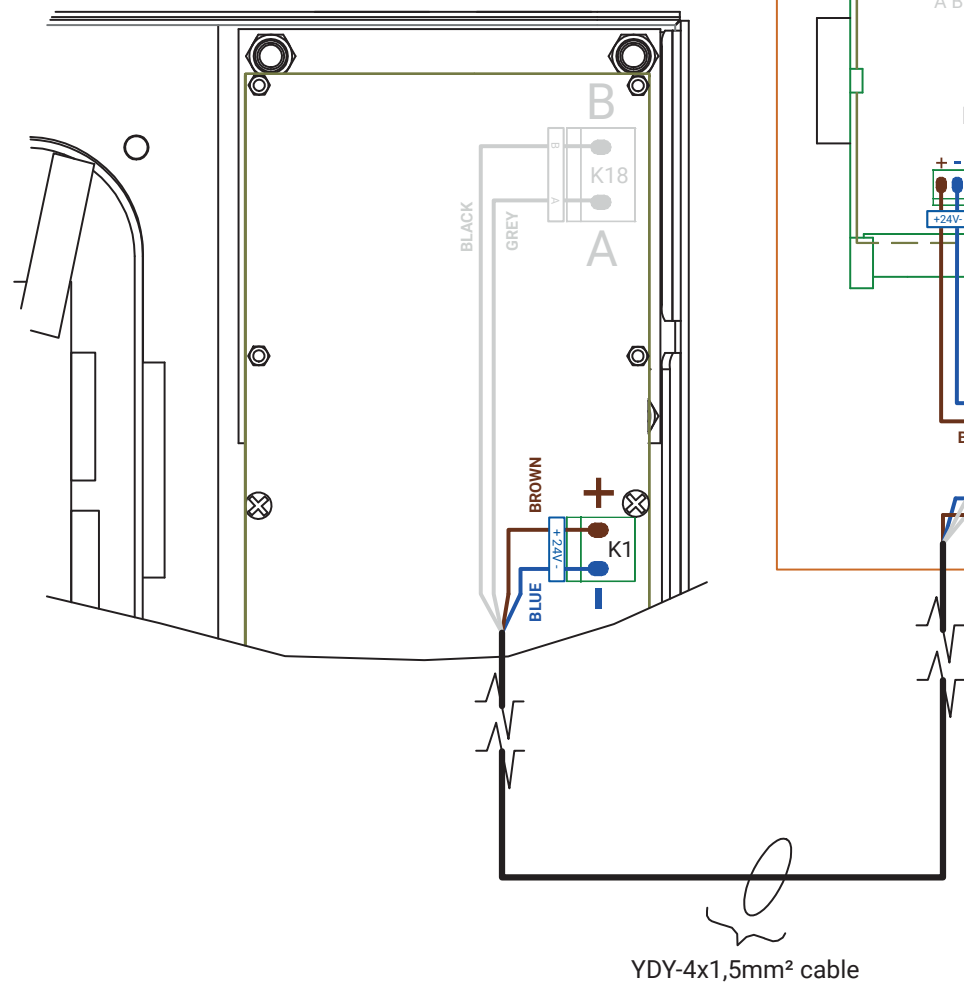

DISTRIBUTION BOX

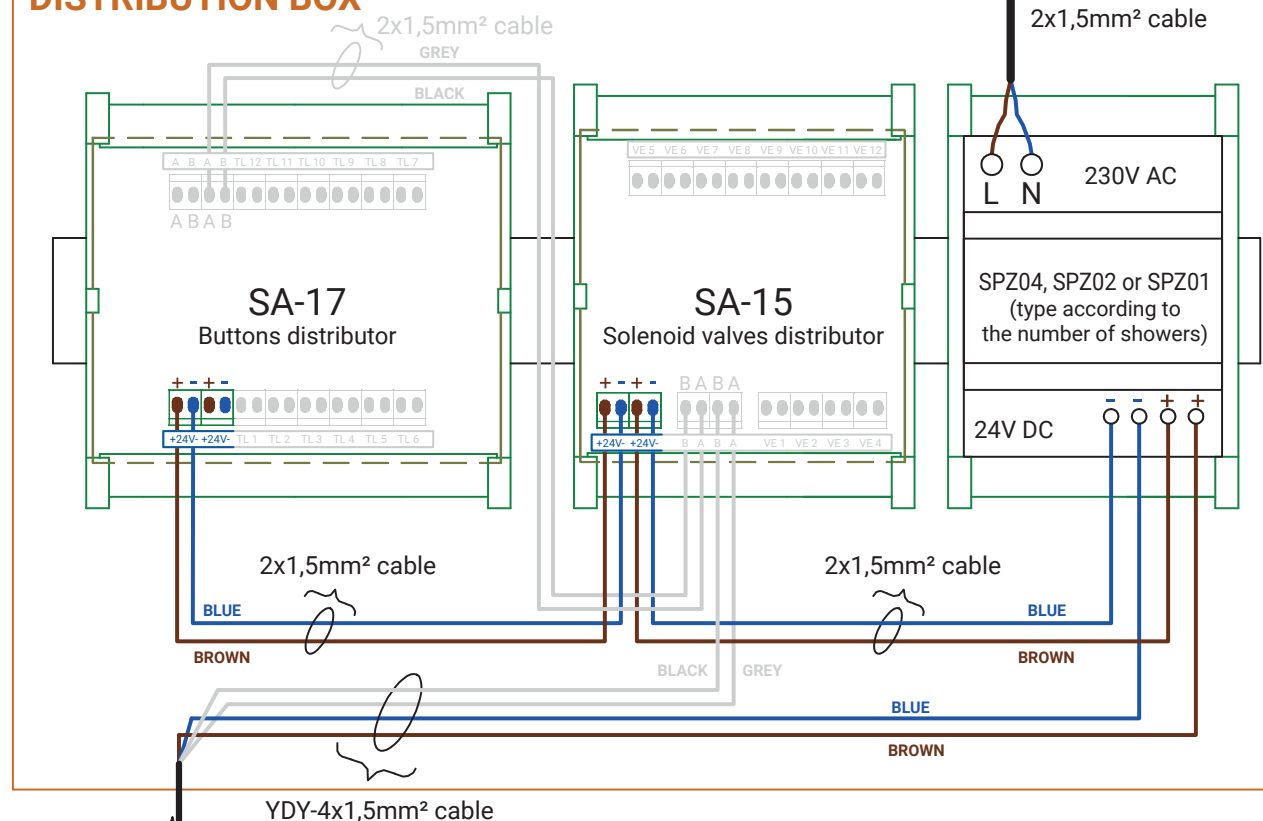

CONNECTION OF THE SA-15 AND SA-17

